

Figure 8.1-7a Violations of the California 1-Hour Ozone Standard (0.09 ppm), 4th Street San Jose, 1988-1997

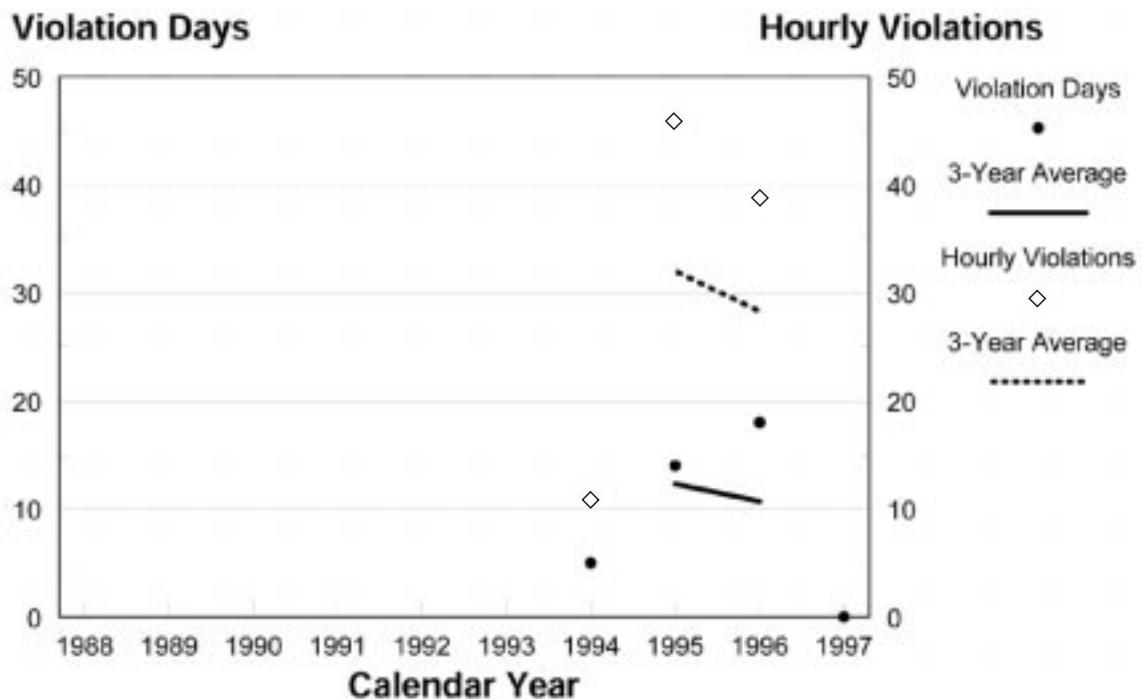


Figure 8.1-7b Violations of the California 1-Hour, Ozone Standard (0.09 ppm) San Martin, 1988-1997

Figure 8.1-7a & b
Metcalf Energy Center
Edited by: Sierra Research, Inc.
Developed by: Sierra Research, Inc.